


# 2009 E. coli Results for TML-Katrine

The Ontario recreational water threshold for E. coli is 100 cfus per 100 ml. (cfu: colony-forming unit)

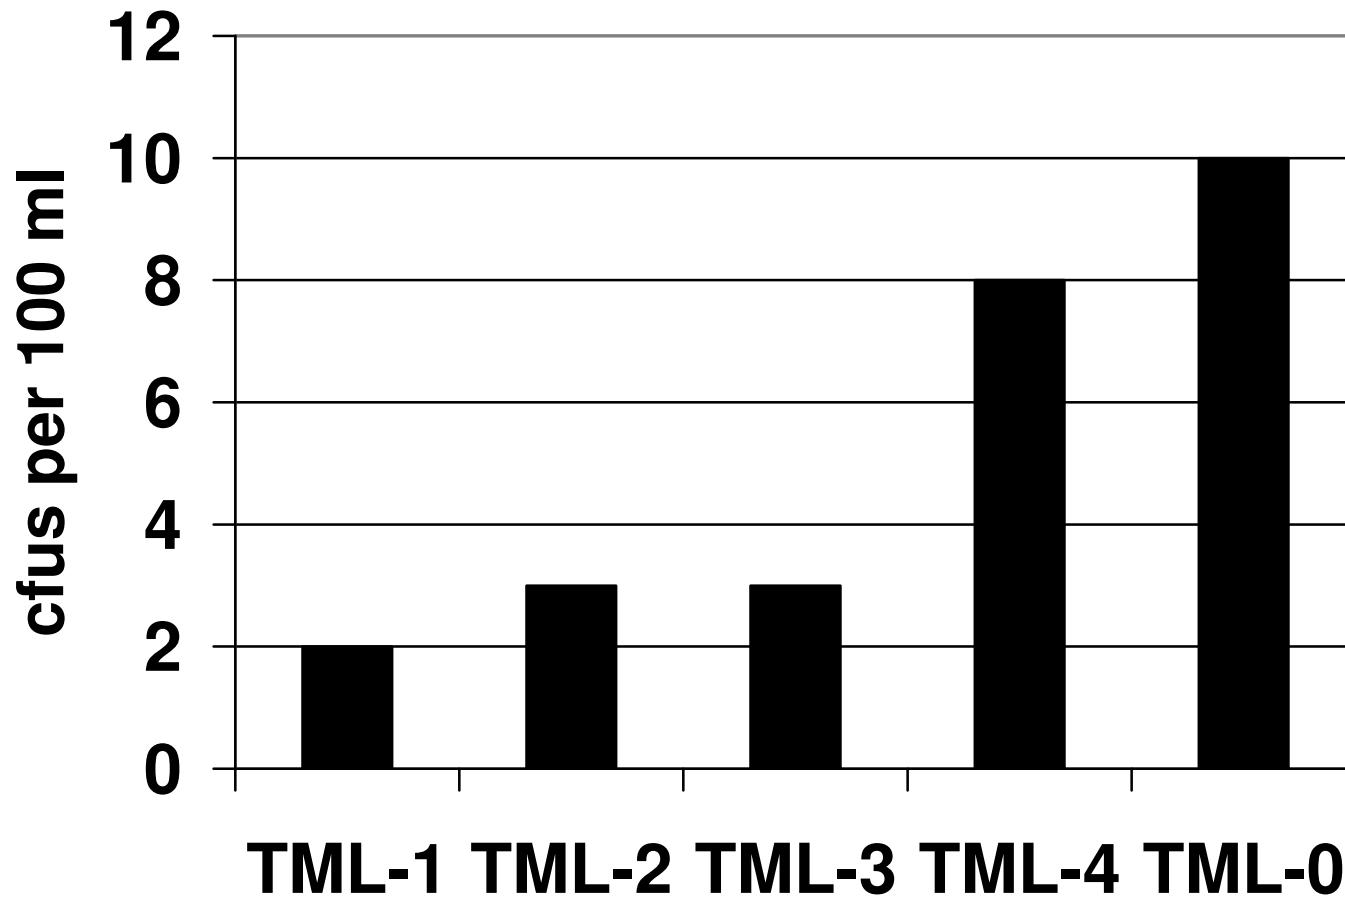

March 21, 2010